

Series EC-11 & EC-14 — 11.2 and 14.0 K-factor Extended Coverage (Light and Ordinary Hazard) Upright, Pendent, and Rec. Pendent Sprinklers

General Description

The Series EC-11 and EC-14 Extended Coverage Upright and Pendent Sprinklers are decorative glass bulb sprinklers designed for use in light or ordinary hazard occupancies. They are intended for use in automatic sprinkler systems designed in accordance with standard installation rules (e.g., NFPA 13) for a maximum coverage area of 400 ft² (37,2 m²), as compared to the maximum coverage area of 130 ft² (12,1 m²) for standard coverage sprinklers used in ordinary hazard occupancies or 225 ft² (20,6 m²) for standard coverage sprinklers used in light hazard occupancies.

The Series EC-11 and EC-14 Sprinklers feature a UL and C-UL Listing that permits their use with unobstructed or non-combustible obstructed ceiling construction as defined and permitted by NFPA 13, as well as a specific application listing for use under concrete tees.

The Series EC-11 and EC-14 Extended Coverage Sprinklers have been fire tested to compare their performance to that of standard coverage spray sprinklers. These tests have shown that the protection provided is equal to or more effective than standard coverage spray sprinklers.

IMPORTANT

Always refer to Technical Data Sheet TFP700 for the "INSTALLER WARNING" that provides cautions with respect to handling and installation of sprinkler systems and components. Improper handling and installation can permanently damage a sprinkler system or its components and cause the sprinkler to fail to operate in a fire situation or cause it to operate prematurely.

Corrosion resistant coatings, where applicable, are utilized to extend the life of copper alloy sprinklers beyond that which would otherwise be obtained when exposed to corrosive atmospheres. Although corrosion resistant coated sprinklers have passed the standard corrosion tests of the applicable approval agencies, the testing is not representative of all possible corrosive atmospheres. Consequently, it is recommended that the end user be consulted with respect to the suitability of these corrosion resistant coatings for any given corrosive environment. The effects of ambient temperature, concentration of chemicals, and gas/chemical velocity, should be considered, as a minimum, along with the corrosive nature of the chemical to which the sprinklers will be exposed.

WARNINGS

The Series EC-11 and EC-14 Extended Coverage Sprinklers described herein must be installed and maintained in compliance with this document, as well as with the applicable standards of the National Fire Protection Association, in addition to the standards of any other authorities having jurisdiction. Failure to do so may impair the performance of these devices.

The owner is responsible for maintaining their fire protection system and devices in proper operating condition. The installing contractor or sprinkler manufacturer should be contacted with any questions.



Model/Sprinkler Identification Number


TY5137 - Upright, 11.2K
TY5237 - Pendent, 11.2K
TY6137 - Upright, 14.0K
TY6237 - Pendent, 14.0K

TY5137 is a redesignation for C5137, G1894, and S2510.

TY5237 is a redesignation for C5237, G1893, and S2511.

TY6137 is a redesignation for C6137, G1896, and S2610.

TY6237 is a redesignation for C6237, G1895, and S2611.

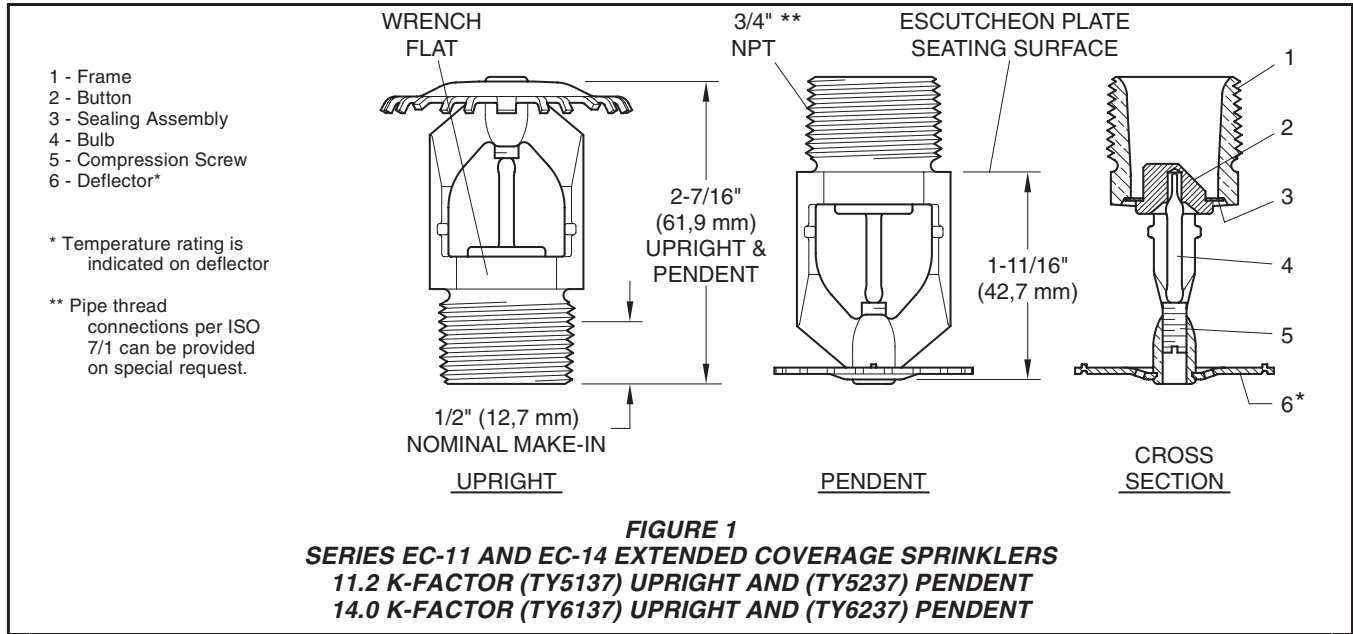

HAZARD	TYPE	TEMP.	BULB LIQUID	SPRINKLER FINISH (See Note 5)			
				NATURAL BRASS	CHROME PLATED	WHITE* POLYESTER	LEAD COATED
LIGHT Refer to Table B for UL and C-UL Sensitivity Rating and Refer to Table C for FM Sensitivity Rating	UPRIGHT K=11.2 (TY5137) PENDENT K=11.2 (TY5237) K=14.0 (TY6237)	135°F/57°C	Orange	1, 2, 3**, 4			
		155°F/68°C	Red				
		175°F/79°C	Yellow	1, 2, 4		1, 2, 4	
		200°F/93°C	Green				
	REC. PENDENT K=11.2 (TY5237) K=14.0 (TY6237) With Style 30 Escutcheon	286°F/141°C	Blue				
		135°F/57°C	Orange	1, 2, 3, 4		N/A	
		155°F/68°C	Red				
		175°F/79°C	Yellow				
		200°F/93°C	Green	1, 2, 4			
		286°F/141°C	Blue				
ORDINARY Refer to Table B for UL and C-UL Sensitivity Rating and Refer to Table C for FM Sensitivity Rating	UPRIGHT K=11.2 (TY5137) K=14.0 (TY6137) and PENDENT K=11.2 (TY5237) K=14.0 (TY6237)	135°F/57°C	Orange	1, 2, 3, 4			
		155°F/68°C	Red				
		175°F/79°C	Yellow				
		200°F/93°C	Green				
	REC. PENDENT K=11.2 (TY5237) K=14.0 (TY6237) With Style 40 Escutcheon	286°F/141°C	Blue				
		135°F/57°C	Orange			N/A	
		155°F/68°C	Red	1, 2, 4			
		175°F/79°C	Yellow				
		200°F/93°C	Green				
		286°F/141°C	Blue				

NOTES:

- Listed by Underwriters Laboratories, Inc. (UL).
 - Listed by Underwriters Laboratories, Inc. for use in Canada (C-UL).
 - Approved by Factory Mutual Research Corporation (FM).
 - Approved by the City of New York under MEA 177-03-E.
 - Where Polyester Coated or Lead Coated Sprinklers are noted to be UL and C-UL Listed, the sprinklers are UL and C-UL Listed as Corrosion Resistant Sprinklers.
- *Frame and Deflector only. Listings and approvals apply to color (Special Order).
 ** Pendent Only.
 N/A: Not Available

TABLE A, LABORATORY LISTINGS AND APPROVALS

AREA	STYLE	LIGHT HAZARD					ORDINARY HAZARD				
		135°F	155°F	175°F	200°F	286°F	135°F	155°F	175°F	200°F	286°F
14 x 14	Up. or Pend.	—	—	—	—	—	SR	SR	SR	SR	SR
14 x 14	Style 30 Recessed	—	—	—	—	—	SR	SR	SR	SR	N/A
14 x 14	Style 40 Recessed	—	—	—	—	—	SR	SR	SR	SR	N/A
16 x 16	Up. or Pend.	QR*	QR*	QR*	QR*	QR*	SR	SR	SR	SR	SR
16 x 16	Style 30 Recessed	QR*	QR*	QR*	QR*	QR*	SR	SR	SR	SR	N/A
16 x 16	Style 40 Recessed	N/A	N/A	N/A	N/A	N/A	SR	SR	SR	SR	N/A
18 x 18	Up. or Pend.	QR*	QR*	QR*	QR*	QR*	SR	SR	SR	SR	SR
18 x 18	Style 30 Recessed	QR*	QR*	QR*	QR*	QR*	SR	SR	SR	SR	N/A
18 x 18	Style 40 Recessed	N/A	N/A	N/A	N/A	N/A	SR	SR	SR	SR	N/A
20 x 20	Up. or Pend.	QR*	QR*	QR*	SR*	SR*	SR	SR	SR	SR	SR
20 x 20	Style 30 Recessed	QR*	SR*	QR*	SR*	SR*	SR	SR	SR	SR	N/A
20 x 20	Style 40 Recessed	N/A	N/A	N/A	N/A	N/A	SR	SR	SR	SR	N/A

QR: Quick Response
 SR: Standard Response
 N/A: Not Applicable
 * Does not apply to Upright K = 14.0

TABLE B
SENSITIVITY RATING FOR UL AND C-UL LISTING OF SERIES EC-11 OR EC-14 SPRINKLERS
 (SEE TABLE D FOR PERMITTED K-FACTOR/AREA COMBINATIONS)

AREA	STYLE	LIGHT HAZARD					ORDINARY HAZARD				
		135°F	155°F	175°F	200°F	286°F	135°F	155°F	175°F	200°F	286°F
14 x 14	Up. or Pend.	—	—	—	—	—	SR	SR	SR	SR	SR
14 x 14	Style 30 Recessed	—	—	—	—	—	N/A	N/A	N/A	N/A	N/A
14 x 14	Style 40 Recessed	—	—	—	—	—	N/A	N/A	N/A	N/A	N/A
16 x 16	Up. or Pend.	QR*	QR*	N/A	N/A	N/A	SR	SR	SR	SR	SR
16 x 16	Style 30 Recessed	QR	QR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
16 x 16	Style 40 Recessed	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
18 x 18	Up. or Pend.	QR*	QR*	N/A	N/A	N/A	SR	SR	SR	SR	SR
18 x 18	Style 30 Recessed	QR	QR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
18 x 18	Style 40 Recessed	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
20 x 20	Up. or Pend.	QR*	QR*	N/A	N/A	N/A	SR	SR	SR	SR	SR
20 x 20	Style 30 Recessed	QR	QR	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
20 x 20	Style 40 Recessed	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

QR: Quick Response
 SR: Standard Response
 N/A: Not Applicable
 * Pendant Only

TABLE C
SENSITIVITY RATING FOR FM APPROVAL OF SERIES EC-11 OR EC-14 SPRINKLERS
 (SEE FM LOSS PREVENTION DATA SHEET 2-8N FOR PERMITTED K-FACTOR/AREA COMBINATIONS)

Technical Data

Approvals

UL and C-UL Listed. FM Approved. (Refer to Table A for complete approval information including corrosion resistant status. The approvals apply to the service conditions indicated in the Design Criteria section.)

Maximum Working Pressure

175 psi (12,1 bar)

Pipe Thread Connection

3/4 inch NPT

Discharge Coefficients

$K = 11.2 \text{ GPM/psi}^{1/2}$
(161,3 LPM/bar^{1/2})
 $K = 14.0 \text{ GPM/psi}^{1/2}$
(201,6 LPM/bar^{1/2})

Temperature Ratings

135°F/57°C to 286°F/141°C

Finish

Sprinkler: Refer to Table A
Recessed Escutcheon: White Coated, Chrome Plated, and Brass Plated

Physical Characteristics

Frame	Bronze
Button	Bronze
Sealing Assembly	
.	Beryllium Nickel w/Teflon [†]
Bulb	Glass (3 mm dia.)
Compression Screw	
.	Bronze
Deflector	Brass

Patents

U.S.A. Patent Numbers 5,366,022; 5,579,846; 5,584,344; 5,609,211; 5,862,994; and 5,865,256.

Operation

The glass bulb contains a fluid which expands when exposed to heat. When the rated temperature is reached, the fluid expands sufficiently to shatter the glass bulb, which then allows the sprinkler to activate and flow water.

Design Criteria

The Series EC-11 and EC-14 Extended Coverage Sprinklers must only be installed in accordance with the applicable UL and C-UL Listing or FM Approval requirements as indicated below. Only the Style 30 or 40 Recessed Escutcheon is to be used for recessed installation, as applicable (Ref. Table A, B, and C).

UL and C-UL Listing Requirements

1. The Series EC-11 and EC-14 Sprinklers may be used for the coverage areas shown in Table D, based on maintaining the minimum specified flow rate as a function of coverage area and hazard group for all of the sprinklers in the design area.

2. The Series EC-11 and EC-14 Sprinklers are permitted to be used with unobstructed or non-combustible obstructed ceiling construction as defined and permitted by NFPA 13. For example:

Unobstructed, combustible or non-combustible, ceiling construction with a deflector to ceiling/roof deck distance of 1 to 12 inches (25 to 300 mm).

Obstructed, non-combustible, ceiling construction with a deflector location below structural members of 1 to 6 inches (25 to 150 mm) and a maximum deflector to ceiling/roof deck distance of 22 inches (550 mm).

3. The Series EC-11 and EC-14 Sprinklers having been specifically tested and listed for non-combustible obstructed construction are permitted to be used within trusses or bar joists having non-combustible web members greater than 1 inch (25.4 mm) when applying the 4 times obstruction criteria rule defined under "Obstructions to Sprinkler Discharge Pattern Development".

4. The minimum allowable spacing between the Series EC-11 and EC-14 Sprinklers, to prevent cold soldering, is 8 feet (2,4 m) for upright sprinklers and 9 feet (2,7 m) for pendent sprinklers.

5. The Series EC-11 and EC-14 Sprinklers are to be installed in accordance with all other requirements of NFPA 13 for extended coverage upright and pendent sprinklers. For ex-

ample: obstructions to sprinkler discharge, obstructions to sprinkler pattern development, obstructions to prevent sprinkler discharge from reaching hazard, clearance to storage, etc.

UL and C-UL Specific Application Listing Requirements For Installation Under Concrete Tees

The Series EC-11 and EC-14 Extended Coverage Upright and Pendent Sprinklers (TY5137, TY5237, TY6137 & TY6237) have a UL and C-UL Specific Application Listing for use under concrete tees when installed as follows:

1. The stems of the concrete tee construction must spaced at less than 7.5 feet (2,3 m) on center but more than 3 feet (0,9 m) on center. The depth of the concrete tees must not exceed 30 inches (762 mm). The maximum permitted concrete tee length is 32 feet (9,8 m); however, where the concrete tee length exceeds 32 feet (9,8 m), non-combustible baffles, equal in height to the depth of the tees, can be installed so that the space between the tees does not exceed 32 feet (9,8 m) in length.

2. The sprinkler deflectors are to be located in a horizontal plane at or above 1 inch (25,4 mm) below the bottom of the concrete tee stems.

3. When the sprinkler deflectors are located higher than a horizontal plane 1 inch (25,4 mm) beneath the bottom of the concrete tee stems, the obstruction to sprinkler discharge criteria requirements of NFPA 13 for extended coverage upright sprinklers applies.

FM Approval Requirements

The Series EC-11 and EC-14 Extended Coverage Sprinklers are to be installed in accordance with the applicable Factory Mutual Loss Prevention Data Sheet for limited use in buildings of specific roof construction and for the protection of certain specific ordinary hazard (non-storage and/or non-flammable or combustible liquid) occupancies. Information provided in the FM Loss Prevention Data Sheets relate to, but are not limited to, hydraulic design, ceiling slope and obstructions, minimum and maximum allowable spacing, and deflector-to ceiling distance.

These criteria may differ from UL and/or NFPA criteria, therefore the designer should review and become familiar with Factory Mutual requirements before proceeding with design.

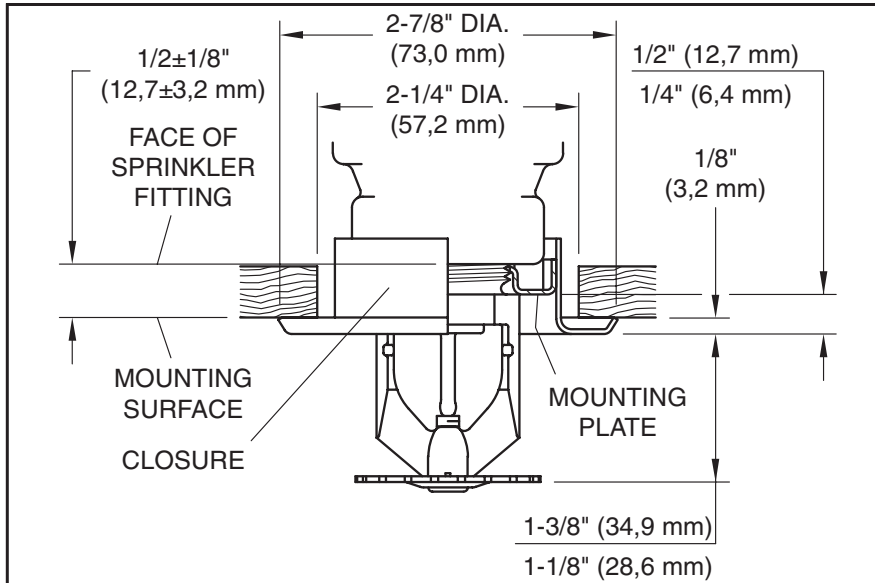


FIGURE 2
SERIES EC-11 AND EC-14 RECESSED PENDENT SPRINKLER ASSEMBLY
WITH TWO-PIECE 1/2 INCH TOTAL ADJUSTMENT
STYLE 30 RECESSED ESCUTCHEON

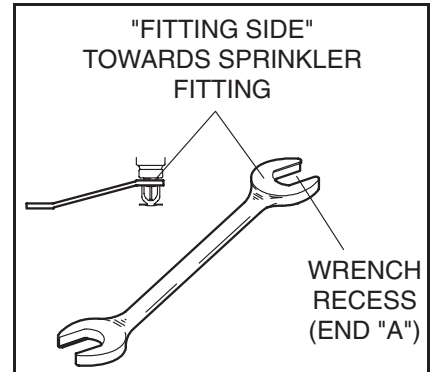


FIGURE 4
W-TYPE 3 SPRINKLER
WRENCH

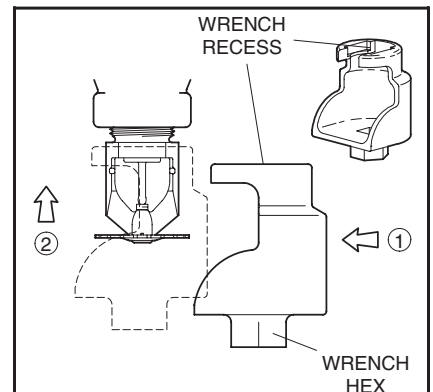


FIGURE 5
W-TYPE 22 RECESSED
SPRINKLER WRENCH

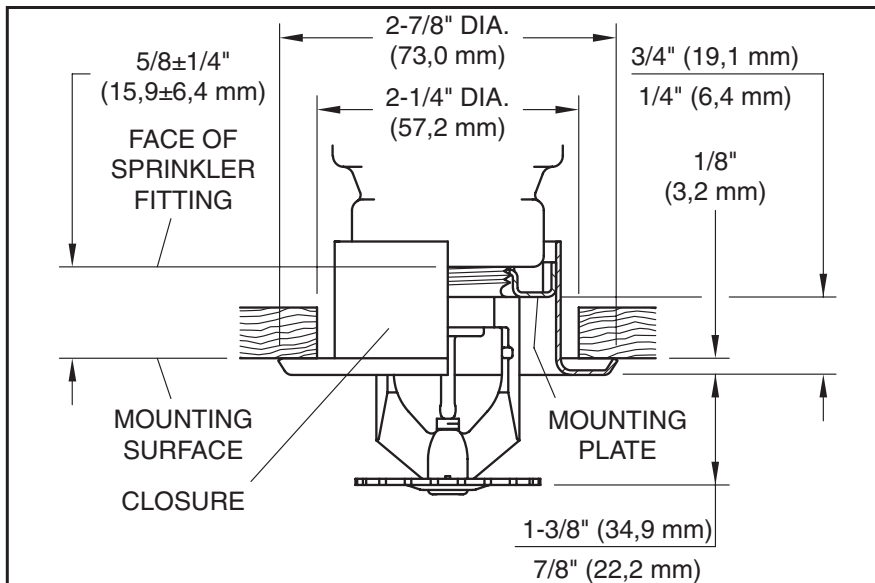


FIGURE 3
SERIES EC-11 AND EC-14 RECESSED PENDENT SPRINKLER ASSEMBLY
WITH TWO-PIECE 3/4 INCH TOTAL ADJUSTMENT
STYLE 40 RECESSED ESCUTCHEON

DESCRIPTION	AREA	LIGHT HAZARD 0.10 GPM/FT ²		GROUP I ORDINARY HAZARD 0.15 GPM/FT ²		GROUP II ORDINARY HAZARD 0.20 GPM/FT ²	
		GPM	PSI	GPM	PSI	GPM	PSI
TY5137 (K=11.2) UPRIGHT	14 x 14	—	—	30	7.2	39	12.1
	16 x 16	30	7.2	39	12.1	51	20.7
	18 x 18	33	8.7	49	19.1	65	33.7
	20 x 20	40	12.8	60	28.7	80	51.0
TY5237 (K=11.2) PENDENT	14 x 14	—	—	30	7.2	39	12.1
	16 x 16	30	7.2	39	12.1	51	20.7
	18 x 18	33	8.7	49	19.1	65	33.7
	20 x 20	40	12.8	60	28.7	80	51.0
TY6137 (K=14.0) UPRIGHT	14 x 14	N/A	N/A	—	—	—	—
	16 x 16	N/A	N/A	39	7.8	51	13.3
	18 x 18	N/A	N/A	49	12.3	65	21.6
	20 x 20	N/A	N/A	60	18.4	80	32.7
TY6237 (K=14.0) PENDENT	14 x 14	—	—	—	—	—	—
	16 x 16	37	7.0	39	7.8	51	13.3
	18 x 18	37	7.0	49	12.3	65	21.6
	20 x 20	40	8.2	60	18.4	80	32.7

1 ft. = 0.3048 m
 1 ft² = 0.093 m²
 1 gpm = 3.785 lpm
 1 psi = 0.06895 bar
 1 gpm/ft² = 40.74 mm/min

TABLE D
FLOW CRITERIA FOR UL AND C-UL LISTING OF SERIES EC-11 AND EC-14 SPRINKLERS

Installation

The Series EC-11 and EC-14 Sprinklers must be installed in accordance with the following instructions:

NOTES

Do not install any bulb type sprinkler if the bulb is cracked or there is a loss of liquid from the bulb. With the sprinkler held horizontally, a small air bubble should be present. The diameter of the air bubble is approximately 1/16 inch (1,6 mm) for the 135°F/57°C to 3/32 inch (2,4 mm) for the 286°F/141°C temperature ratings.

A leak tight 3/4 inch NPT sprinkler joint should be obtained with a torque of 10 to 20 ft.lbs. (13,4 to 26,8 Nm). A maximum of 30 ft.lbs. (40.7 Nm) of torque is to be used to install sprinklers. Higher levels of torque may distort the sprinkler inlet with consequent leakage or impairment of the sprinkler.

Do not attempt to compensate for insufficient adjustment in an Escutcheon Plate by under- or over-tightening the Sprinkler. Readjust the position of the sprinkler fitting to suit.

Step 1. The sprinkler must be installed with the deflector parallel to the mounting surface. Pendent sprinklers must be installed in the pendent position, and upright sprinklers must be installed in the upright position.

Step 2. After installing the Style 30 or 40 mounting plate (or other escutcheon, as applicable) over the sprinkler pipe threads and with pipe thread sealant applied to the pipe threads, hand tighten the sprinkler into the sprinkler fitting.

Step 3. Wrench tighten upright or pendent sprinklers using only the W-Type 3 (End A) Sprinkler Wrench. Wrench tighten the recessed pendent sprinklers using only the W-Type 22 Sprinkler Wrench. The wrench recess of the applicable sprinkler wrench (Ref. Figure 4 and 5) is to be applied to the sprinkler wrench flats (Ref. Figure 1).

Care and Maintenance

The Series EC-11 and EC-14 Sprinklers must be maintained and serviced in accordance with the following instructions:

NOTE

Before closing a fire protection system main control valve for maintenance work on the fire protection system that it controls, permission to shut down the affected fire protection systems must be obtained from the proper authorities and all personnel who may be affected by this action must be notified.

Sprinklers that are found to be leaking or exhibiting visible signs of corrosion must be replaced.

Automatic sprinklers must never be painted, plated, coated, or otherwise altered after leaving the factory. Modified sprinklers must be replaced. Sprinklers that have been exposed to corrosive products of combustion, but have not operated, should be replaced if they cannot be completely cleaned by wiping the sprinkler with a cloth or by brushing it with a soft bristle brush.

Care must be exercised to avoid damage to the sprinklers - before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced. Also, replace any sprinkler that has a cracked bulb or that has lost liquid from its bulb. (Ref. Installation Section).

Frequent visual inspections are recommended to be initially performed for corrosion resistant coated sprinklers, after the installation has been completed, to verify the integrity of the corrosion resistant coating. Thereafter, annual inspections per NFPA 25 should suffice; however, instead of inspecting from the floor level, a random sampling of close-up visual inspections should be made, so as to better determine the exact sprinkler condition and the long term integrity of the corrosion resistant coating, as it may be affected by the corrosive conditions present.

The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the National Fire Protection Association (e.g., NFPA 25), in addition to the standards of any other authorities having jurisdiction. The in-

stalling contractor or sprinkler manufacturer should be contacted relative to any questions.

It is recommended that automatic sprinkler systems be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national codes.

Limited Warranty

Products manufactured by Tyco Fire Products are warranted solely to the original Buyer for ten (10) years against defects in material and workmanship when paid for and properly installed and maintained under normal use and service. This warranty will expire ten (10) years from date of shipment by Tyco Fire Products. No warranty is given for products or components manufactured by companies not affiliated by ownership with Tyco Fire Products or for products and components which have been subject to misuse, improper installation, corrosion, or which have not been installed, maintained, modified or repaired in accordance with applicable Standards of the National Fire Protection Association, and/or the standards of any other Authorities Having Jurisdiction. Materials found by Tyco Fire Products to be defective shall be either repaired or replaced, at Tyco Fire Products' sole option. Tyco Fire Products neither assumes, nor authorizes any person to assume for it, any other obligation in connection with the sale of products or parts of products. Tyco Fire Products shall not be responsible for sprinkler system design errors or inaccurate or incomplete information supplied by Buyer or Buyer's representatives.

IN NO EVENT SHALL TYCO FIRE PRODUCTS BE LIABLE, IN CONTRACT, TORT, STRICT LIABILITY OR UNDER ANY OTHER LEGAL THEORY, FOR INCIDENTAL, INDIRECT, SPECIAL OR CONSEQUENTIAL DAMAGES, INCLUDING BUT NOT LIMITED TO LABOR CHARGES, REGARDLESS OF WHETHER TYCO FIRE PRODUCTS WAS INFORMED ABOUT THE POSSIBILITY OF SUCH DAMAGES, AND IN NO EVENT SHALL TYCO FIRE PRODUCTS' LIABILITY EXCEED AN AMOUNT EQUAL TO THE SALES PRICE.

THE FOREGOING WARRANTY IS MADE IN LIEU OF ANY AND ALL OTHER WARRANTIES EXPRESS OR IMPLIED, INCLUDING WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE.

Ordering Procedure

When placing an order, indicate the full product name. Please specify the Sprinkler Identification Number (SIN), quantity, and temperature rating. Refer to the Price List for complete listing of Part Numbers.

Contact your local distributor for availability.

Sprinkler Assemblies with NPT Thread Connections:

Specify: (specify SIN), (specify K-Factor), (specify temperature rating), (specify Pendent or Upright) Extended Coverage Sprinkler with (specify finish), P/N (specify - from Table E, where applicable).

Recessed Escutcheon:

Specify: Style (specify 30 or 40) Recessed Escutcheon with (specify finish), P/N (specify).

Style 30 Recessed Escutcheon
 Chrome Plated PSN 56-705-9-011
 White Color Coated PSN 56-705-4-011
 White (RAL9010)* PSN 56-705-3-011
 Brass Plated PSN 56-705-2-011

Style 40 Recessed Escutcheon
 Chrome Plated PSN 56-700-9-010
 White Color Coated PSN 56-700-4-010
 White (RAL9010)* PSN 56-700-3-010
 Brass Plated PSN 56-700-2-010

*Eastern Hemisphere sales only.

Sprinkler Wrench:

Specify: W-Type 3 Sprinkler Wrench, P/N 56-895-1-001

Specify: W-Type 22 Recessed Sprinkler Wrench, P/N 56-665-7-001

<p>P/N 51 - AAA - B -CCC</p> <p>AAA = 893 (for TY5237 K11.2 Pendent) AAA = 894 (for TY5137 K11.2 Upright) AAA = 895 (for TY6237 K14.0 Pendent) AAA = 896 (for TY6137 K14.0 Upright)</p> <p>B = 1 (for Natural Brass) B = 3 (for White [RAL9010])* B = 4 (for White Polyester) B = 7 (for Lead Coated) B = 9 (for Chrome Plated)</p> <p>CCC = 135 (for 135°F/57°C) CCC = 155 (for 155°F/68°C) CCC = 175 (for 175°F/79°C) CCC = 200 (for 200°F/93°C)</p> <p>*Eastern Hemisphere sales only.</p> <p style="text-align: center;">TABLE E PART NUMBERS FOR EC-11 AND EC-14 SPRINKLERS</p>
--